

TIMER DELETION KIT FITTING INSTRUCTIONS

This kit is suitable for the following products:

Independent Combi 24	G.C. No. 47-349-24
Independent Combi 30	G.C. No. 47-349-25
Independent Combi 35	G.C. No. 47-349-26
Independent + Combi 24	G.C. No. 47-349-27
Independent + Combi 30	G.C. No. 47-349-28
Independent + Combi 35	G.C. No. 47-349-29

KIT CONTENTS:

- Link Wire - 1 off
- Timer Blanking Plate - 1 off



ALWAYS switch off and disconnect the electricity supply to the appliance before installing this kit. Merely switching the boiler OFF/SUMMER/WINTER/RESTART switch to 'OFF' will still leave a live feed to the boiler.

REMOVAL OF MECHANICAL TIMER

1. Ease out the mechanical timer using the two screwdriver slots situated at the bottom edge of the timer housing.
2. Disconnect the lead from the control box to the Mechanical Timer.
3. Connect the link wire plug.
4. Locate and push the blanking plate into the control box housing.
5. Power up the boiler and check for correct operation.

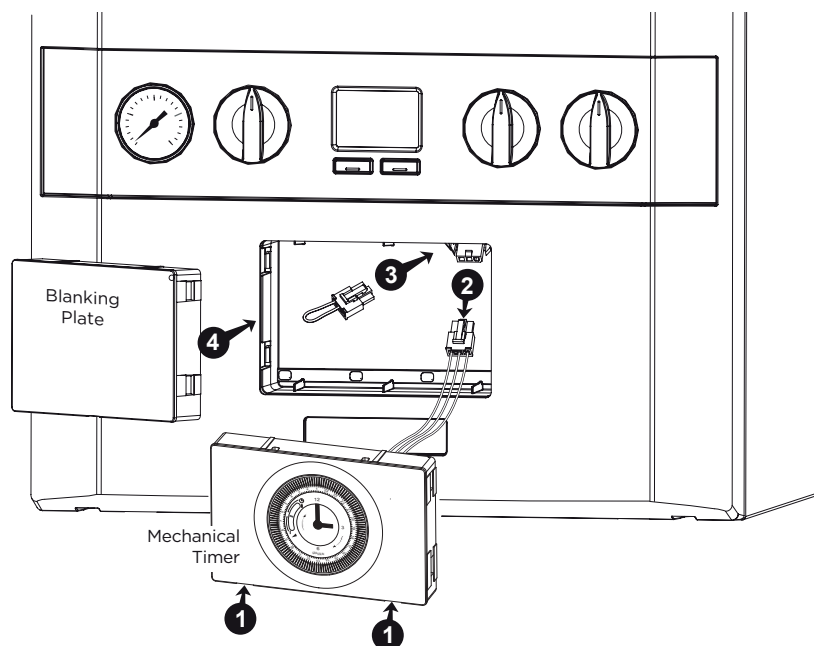


DIAGRAM A:

Programmable Room Stat or Room Stat with Internal Timer

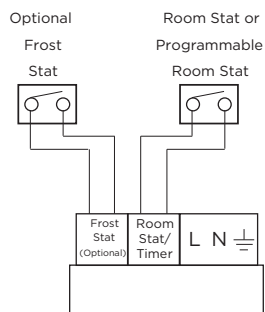


DIAGRAM B:

Room Stat with External Timer

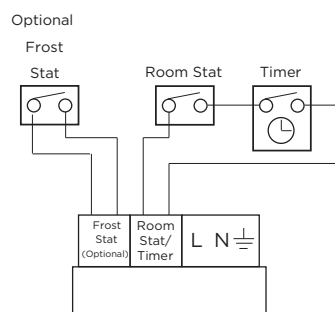


DIAGRAM C:

Use of General Live for Room Stat

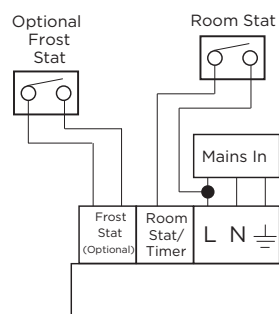


DIAGRAM D:

OpenTherm Device

DO NOT CONNECT 230V TO THESE TERMINALS OR THE BOILER ELECTRONICS WILL BE DAMAGED

